



Simec AG

Areal Bleiche West Postfach 413 CH - 4800 Zofingen
Telefon +41 62 752 83 08 Fax +41 62 752 83 09
E-Mail: info@simec.ch www.simec.ch

Test report

Number **C 42790**

Object of analysis: **Geneza GP Deca 250**

Customer:

Samples: **1**

Batch: **GP234H, Exp. 07/2019**

Receipt: **07.04.2016**

Subject: **Nandrolone decanoate: Assay, Identification**

Method(s): **HPLC**

Sample / Analysis:	Method	Status	Result	Specification	complies
<u>Nandrolone decanoate:</u>					
Identification	HPLC	N	complies	complies	yes
Content	HPLC	N	262.4 mg/mL	250 mg/mL	-

Method-status: G = GMP A = accredited V = generally validated P = validated on product N = not validated
E = external lab

Remarks: The sample(s) mentioned above have been analysed as they have been sent to us by the client. We have not controlled external processes like manufacturing, labelling, sampling, shipping, storage. These results are for information only and do not compensate for correct quality control by the manufacturer/distributor. Generally, pharmaceutical products have to be produced and distributed under full GMP/GDP regime, including GMP-compliant analyses with validated methods.

Signatures:
controlled & released:

Staff:

completed:
27.04.2016


The enclosed results refer exclusively to the object of examination described above.
The measuring accuracy is available on request. Only handwritten signatures are valid.
Without written permission, it is not allowed to publish single parts of this report.

page 1 of 1

Report steroid analysis

HPLC: Nr.5
 Analysendatum: 23.04.2016 02:43:59
 Vial: 29
 Probenidentifikation: C42790 A
 Operator: admin
 Chrom.-Beding. ACN / Wasser, gradient
 Temperatur: 40 °C
 Säule Nr. 121, 250 x 4,6, C18
 Detektion: UV 240nm

Druckdatum: 25.04.2016 08:56:54
 Injektvolumen: 20

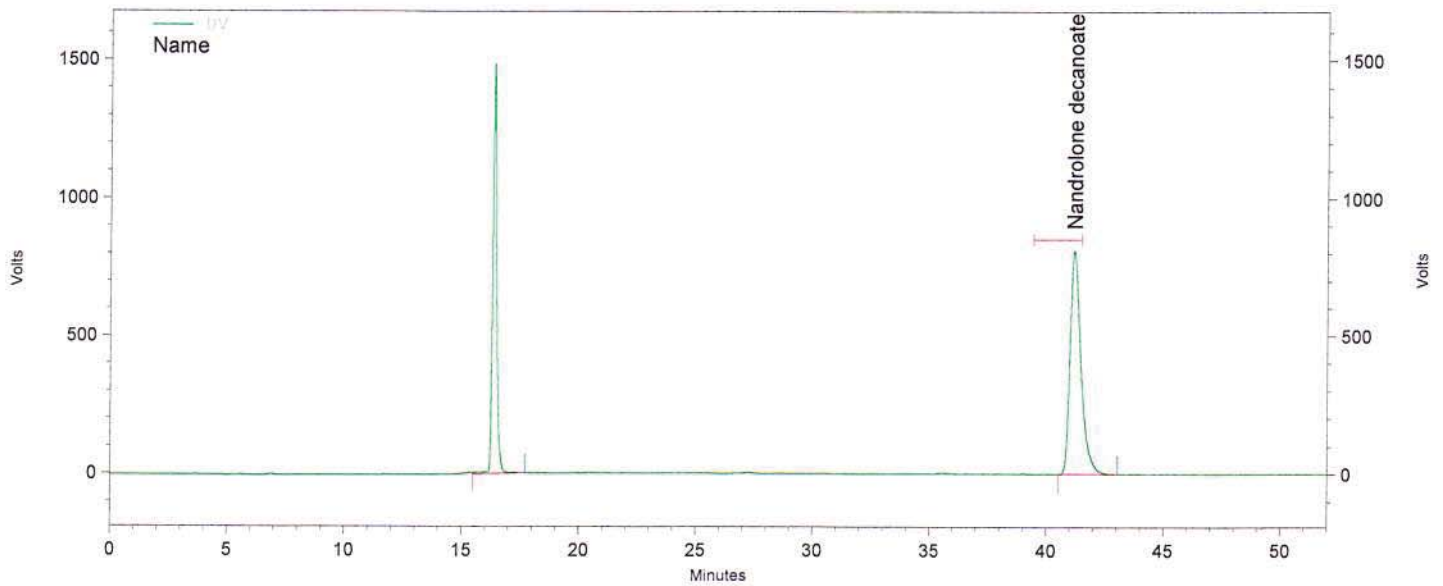

Channel A

UV Results


Name	Time	Area	Amount	Area Percent
Nandrolone decanoate	41,173	104668724	0,000	59,660
Totals		175440892	0,000	100,000

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\April 2016\Diverse Steroide\19,04,16\037_C42790 A-Rep1.dat
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Steroide A.met

Report steroid analysis

HPLC: Nr.5
 Analysendatum: 23.04.2016 03:37:25
 Vial: 29
 Probenidentifikation: C42790 A
 Operator: admin
 Chrom.-Beding.: ACN / Wasser, gradient
 Temperatur: 40 °C
 Säule: Nr. 121, 250 x 4,6, C18
 Detektion: UV 240nm

Druckdatum: 25.04.2016 08:56:58
 Injektvolumen: 20

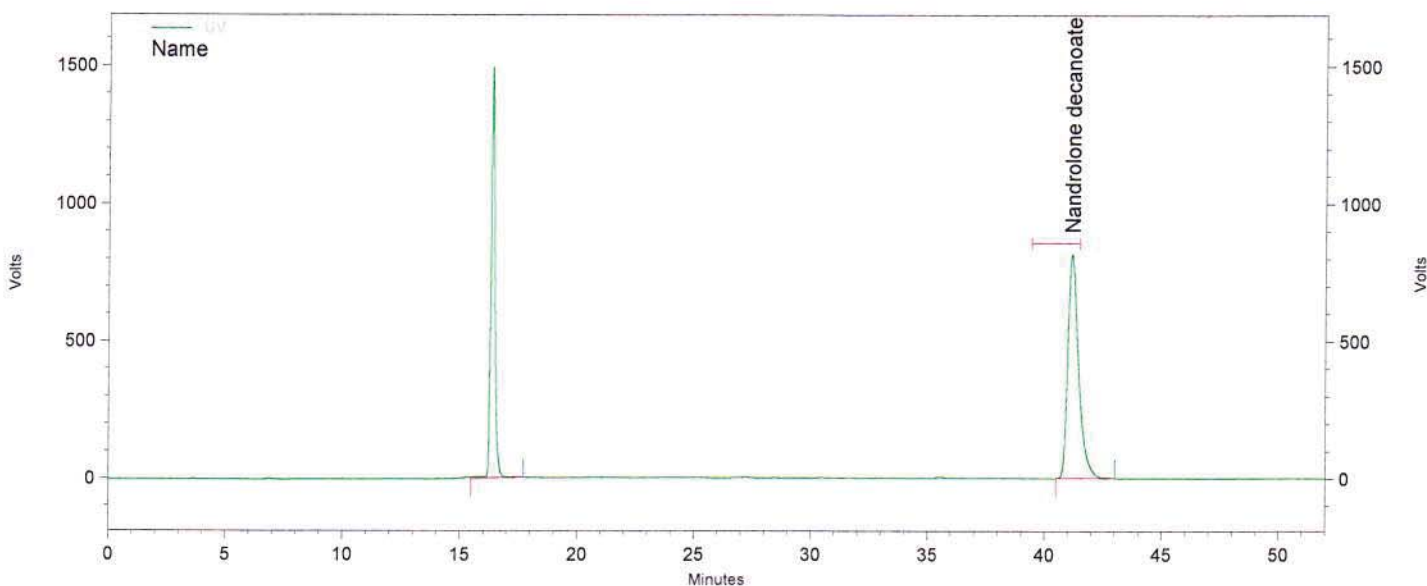

Channel A


UV Results				
Name	Time	Area	Amount	Area Percent
	16,367	71148756	0,000	40,324
Nandrolone decanoate	41,153	105295192	0,000	59,676
Totals		176443948	0,000	100,000

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\April 2016\Diverse Steroide\19,04,16\037_C42790 A-Rep2.dat
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Steroide A.met

Report steroid analysis

HPLC: Nr.5
 Analysendatum: 23.04.2016 04:30:52
 Vial: 29
 Probenidentifikation: C42790 A
 Operator: admin
 Chrom.-Beding. ACN / Wasser, gradient
 Temperatur: 40 °C
 Säule Nr. 121, 250 x 4,6, C18
 Detektion: UV 240nm

Druckdatum: 25.04.2016 08:57:02
 Injektvolumen: 20

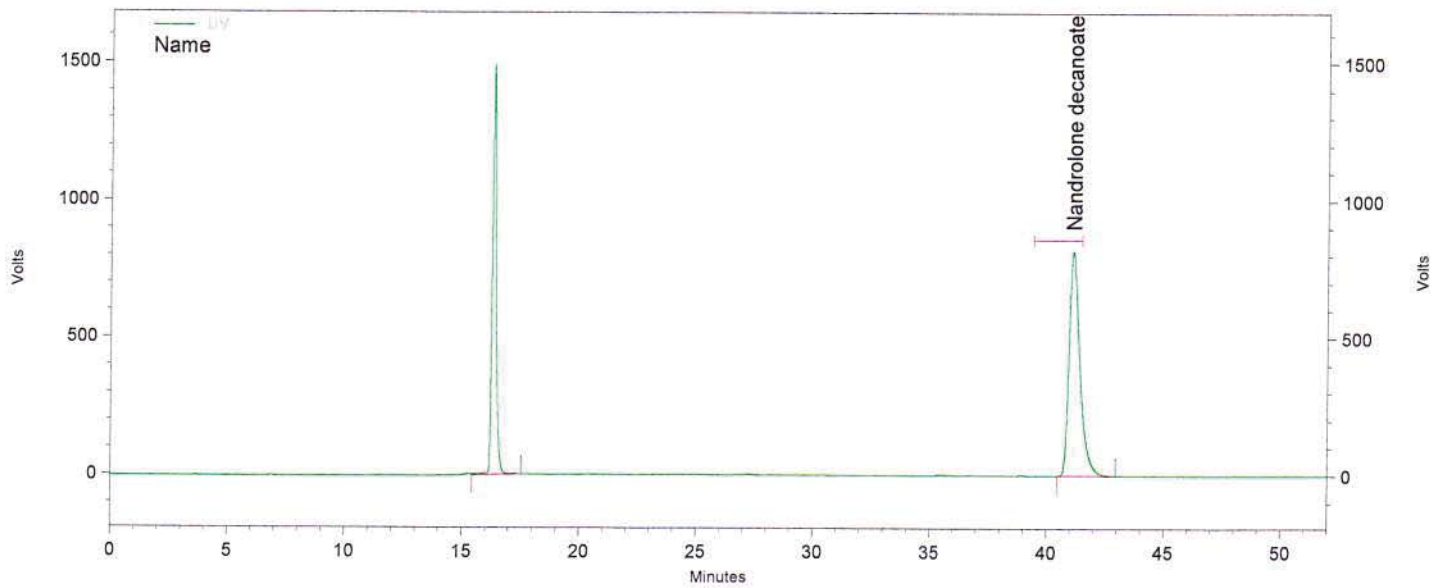

Channel A

UV Results


Name	Time	Area	Amount	Area Percent
	16,330	70985398	0,000	40,262
Nandrolone decanoate	41,117	105325424	0,000	59,738

Totals		176310822	0,000	100,000
--------	--	-----------	-------	---------

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\April 2016\Diverse Steroide\19,04,16\037_C42790 A-Rep3.dat
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Steroide A.met

Report steroid analysis

HPLC:	Nr.5	Druckdatum:	25.04.2016 08:57:06
Analysendatum:	23.04.2016 05:24:18	Injektvolumen:	20
Vial:	30		
Probenidentifikation:	C42790 B		
Operator:	admin		
Chrom.-Beding.	ACN / Wasser, gradient		
Temperatur:	40 °C		
Säule	Nr. 121, 250 x 4,6, C18		
Detektion:	UV 240nm		

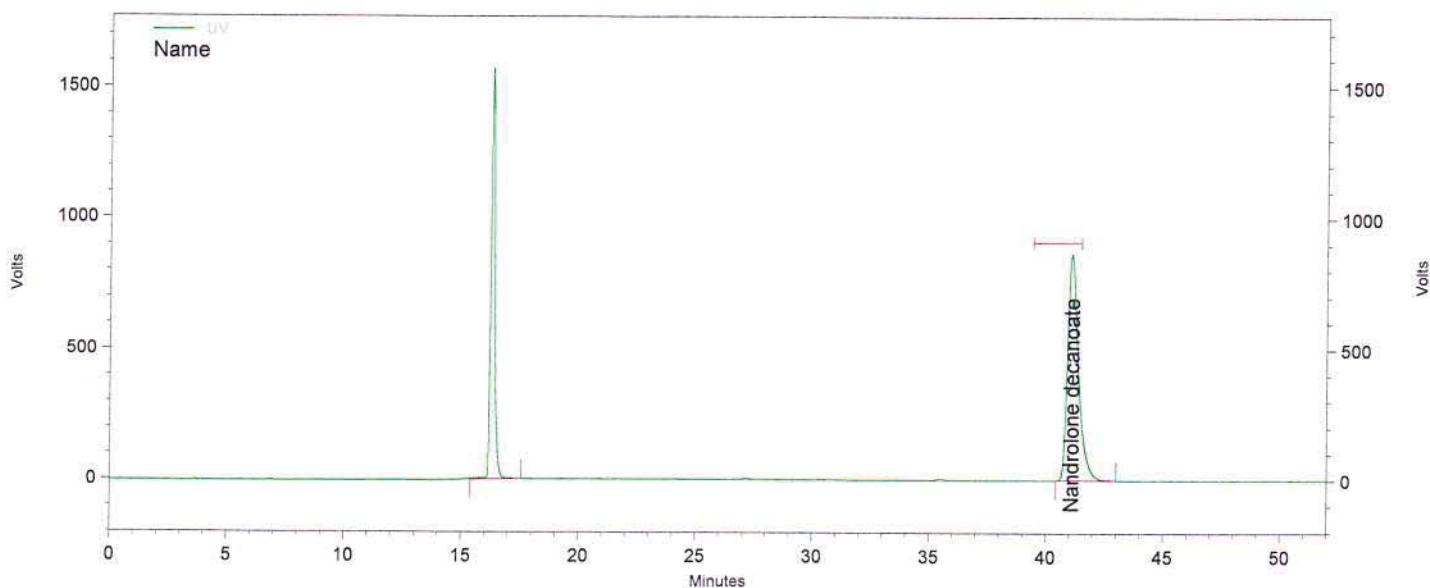

Channel A

UV Results


Name	Time	Area	Amount	Area Percent
Nandrolone decanoate	16,293	74866548	0,000	40,052
	41,077	112057710	0,000	59,948

Totals		186924258	0,000	100,000
--------	--	-----------	-------	---------

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\April 2016\Diverse Steroide\19,04,16\038_C42790 B-Rep1.dat
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Steroide A.met

Report steroid analysis

HPLC:	Nr.5	Druckdatum:	25.04.2016 08:57:10
Analysendatum:	23.04.2016 06:17:42	Injektvolumen:	20
Vial:	30		
Probenidentifikation:	C42790 B		
Operator:	admin		
Chrom.-Beding.	ACN / Wasser, gradient		
Temperatur:	40 °C		
Säule	Nr. 121, 250 x 4,6, C18		
Detektion:	UV 240nm		

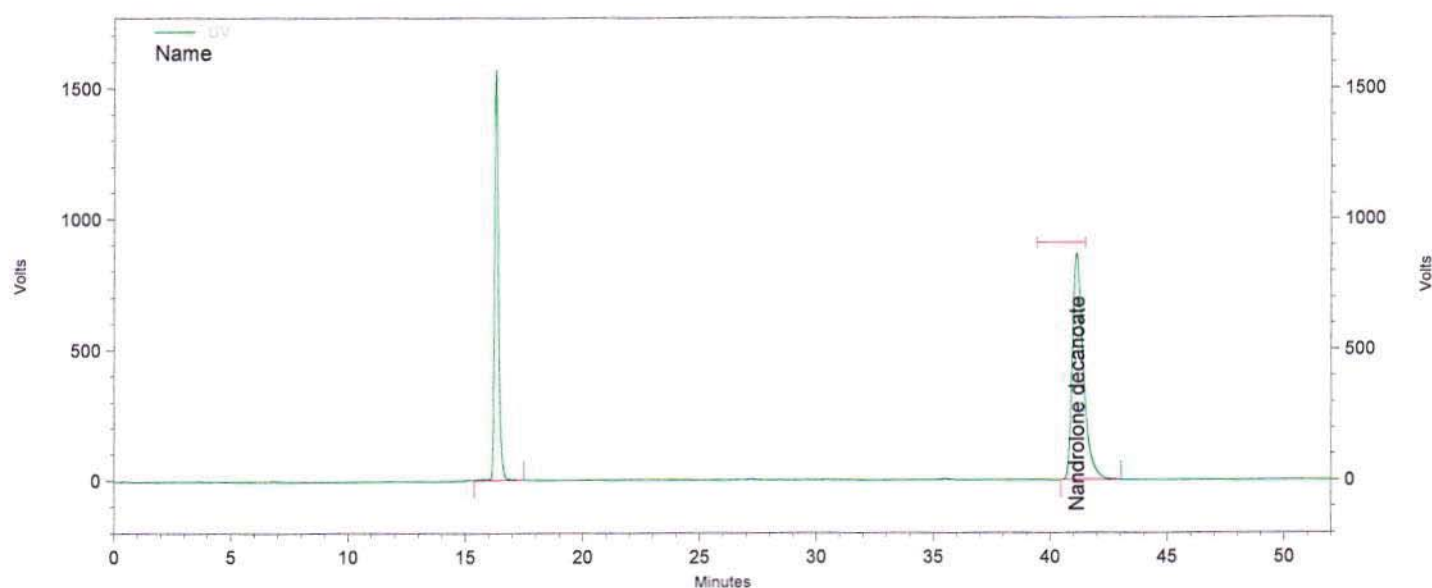

Channel A

UV Results

Name	Time	Area	Amount	Area Percent
	16,287	74809960	0,000	40,038
Nandrolone decanoate	41,113	112038574	0,000	59,962


Totals		186848534	0,000	100,000
--------	--	-----------	-------	---------

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\April 2016\Diverse Steroide\19,04,16\038_C42790 B-Rep2.dat
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Steroide A.met

Report steroid analysis

HPLC: Nr.5
 Analysendatum: 23.04.2016 07:11:11
 Vial: 30
 Probenidentifikation: C42790 B
 Operator: admin
 Chrom.-Beding.: ACN / Wasser, gradient
 Temperatur: 40 °C
 Säule: Nr. 121, 250 x 4,6, C18
 Detektion: UV 240nm

Druckdatum: 25.04.2016 08:57:14
 Injektvolumen: 20

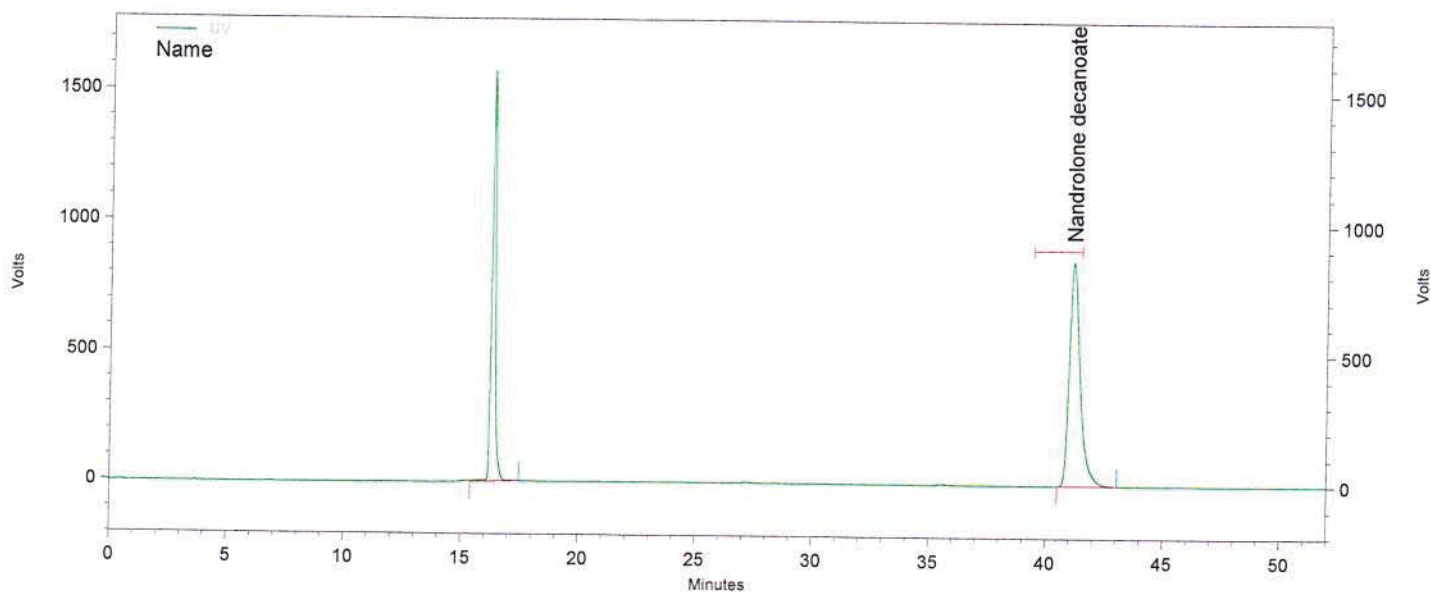

Channel A

UV Results

Name	Time	Area	Amount	Area Percent
Nandrolone decanoate	16,300	74328218	0,000	39,971
Nandrolone decanoate	41,140	111627944	0,000	60,029
Totals		185956162	0,000	100,000

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\April 2016\Diverse Steroide\19,04,16\038_C42790 B-Rep3.dat
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Steroide A.met