



Simec AG

Areal Bleiche West Postfach 413 CH - 4800 Zofingen  
Telefon +41 62 752 83 08 Fax +41 62 752 83 09  
E-Mail: info@simec.ch www.simec.ch

# Test report

Number **C 42810**

Object of analysis: **Geneza GP Oxy**

Customer:

Samples: **1**

Batch: **GP672H, Exp. 09/2017**

Receipt: **07.04.2016**

Subject: **Oxymetholone: Assay, Identification**

Method(s): **HPLC**

Sample / Analysis:	Method	Status	Result	Specification	complies
<b>Oxymetholone:</b>					
Identification	HPLC	N	complies	complies	yes
Content	HPLC	N	51.1 mg/tablet	50 mg/tablet	-

Method-status: G = GMP A = accredited V = generally validated P = validated on product N = not validated  
E = external lab

**Remarks:** The sample(s) mentioned above have been analysed as they have been sent to us by the client. We have not controlled external processes like manufacturing, labelling, sampling, shipping, storage. These results are for information only and do not compensate for correct quality control by the manufacturer/distributor. Generally, pharmaceutical products have to be produced and distributed under full GMP/GDP regime, including GMP-compliant analyses with validated methods.

**Signatures:**   
**controlled & released:**

**Staff:**


**completed:**  
**27.04.2016**

The enclosed results refer exclusively to the object of examination described above. The measuring accuracy is available on request. Only handwritten signatures are valid. Without written permission, it is not allowed to publish single parts of this report.

Report steroid analysis

HPLC: Nr.5  
 Analysendatum: 26.04.2016 01:03:47  
 Vial: 52  
 Probenidentifikation: C42810 A  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Temperatur: 40 °C  
 Säule Nr. 85, 250 x 4,6, C18  
 Detektion: UV 240nm

Druckdatum: 26.04.2016 11:06:55  
 Injektvolumen: 20

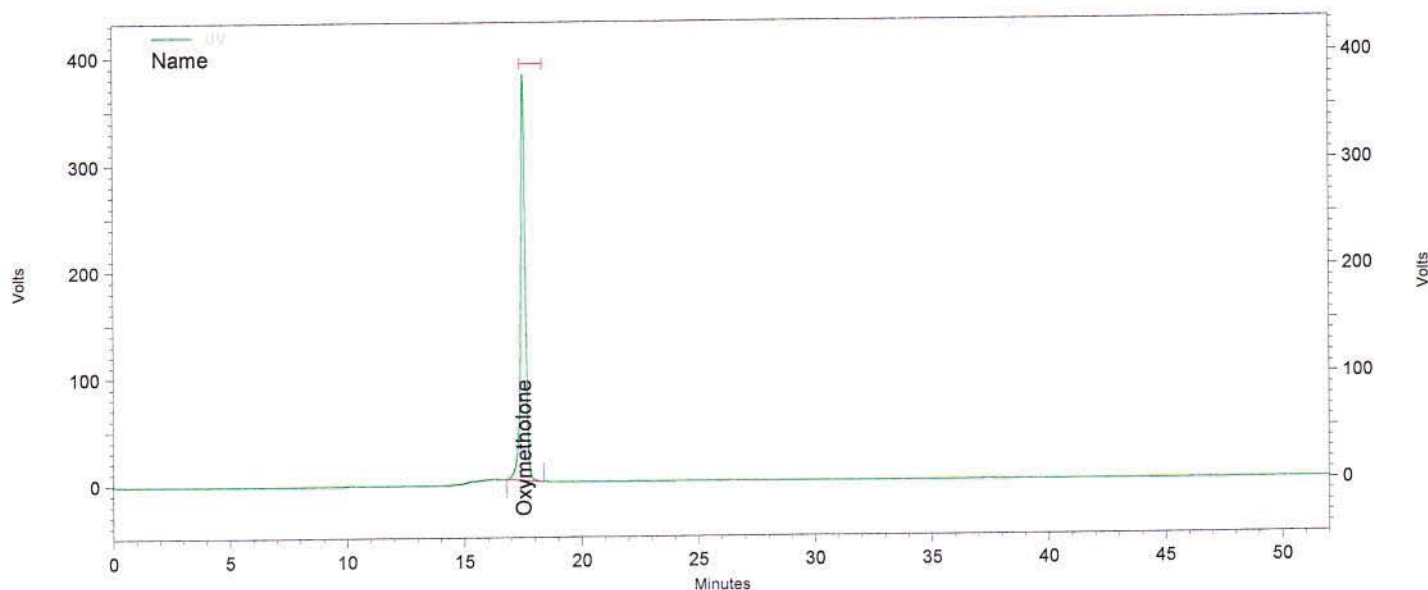

Channel A


UV Results				
Name	Time	Area	Amount	Area Percent
Oxymetholone	17,530	21285763	0,000	100,000
Totals		21285763	0,000	100,000

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\April 2016\Diverse  
 Steroide\19,04,16\067\_C42810 A-Rep1.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Oxymetholone\_UV290.met

Report steroid analysis

HPLC: Nr.5  
 Analysendatum: 26.04.2016 01:57:18  
 Vial: 52  
 Probenidentifikation: C42810 A  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Temperatur: 40 °C  
 Säule Nr. 85, 250 x 4,6, C18  
 Detektion: UV 240nm

Druckdatum: 26.04.2016 11:07:00  
 Injektvolumen: 20

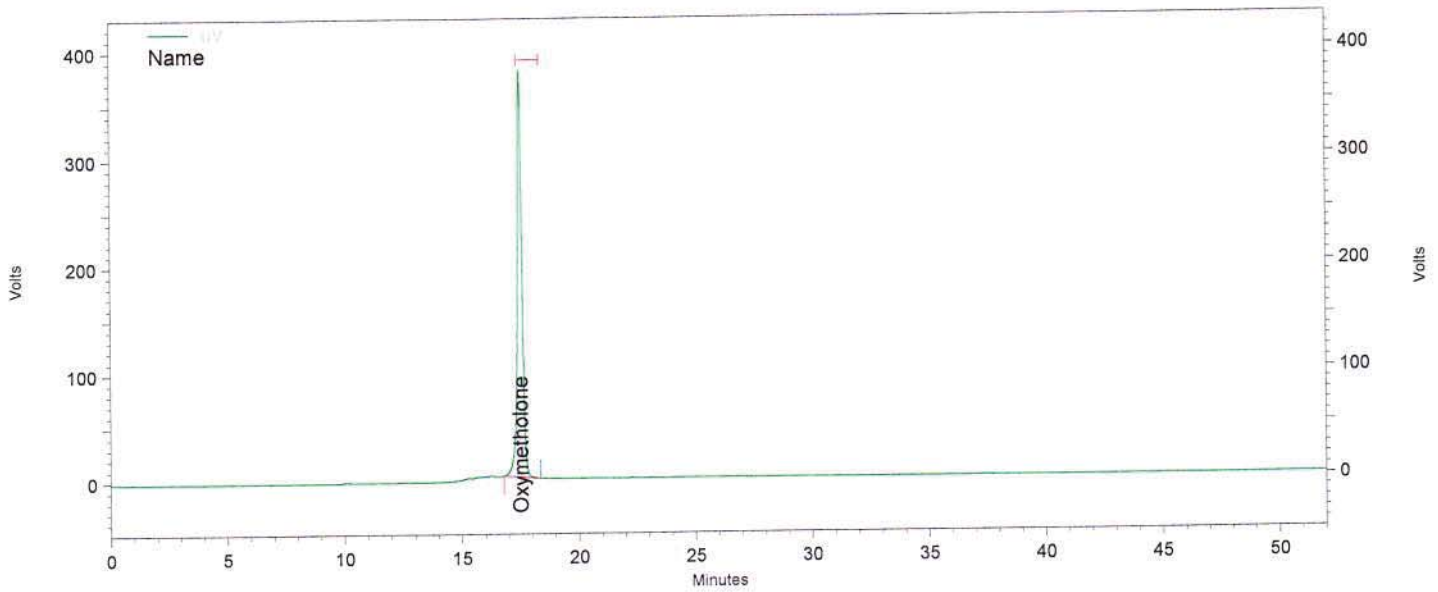

Channel A

UV Results

Name	Time	Area	Amount	Area Percent
Oxymetholone	17,517	21291513	0,000	100,000


Totals		21291513	0,000	100,000
--------	--	----------	-------	---------

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\April 2016\Diverse Steroide\19,04,16\067\_C42810 A-Rep2.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Oxymetholone\_UV290.met

Report steroid analysis

HPLC: Nr.5  
 Analysendatum: 26.04.2016 02:50:40  
 Vial: 52  
 Probenidentifikation: C42810 A  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Temperatur: 40 °C  
 Säule Nr. 85, 250 x 4,6, C18  
 Detektion: UV 240nm

Druckdatum: 26.04.2016 11:07:04  
 Injektvolumen: 20

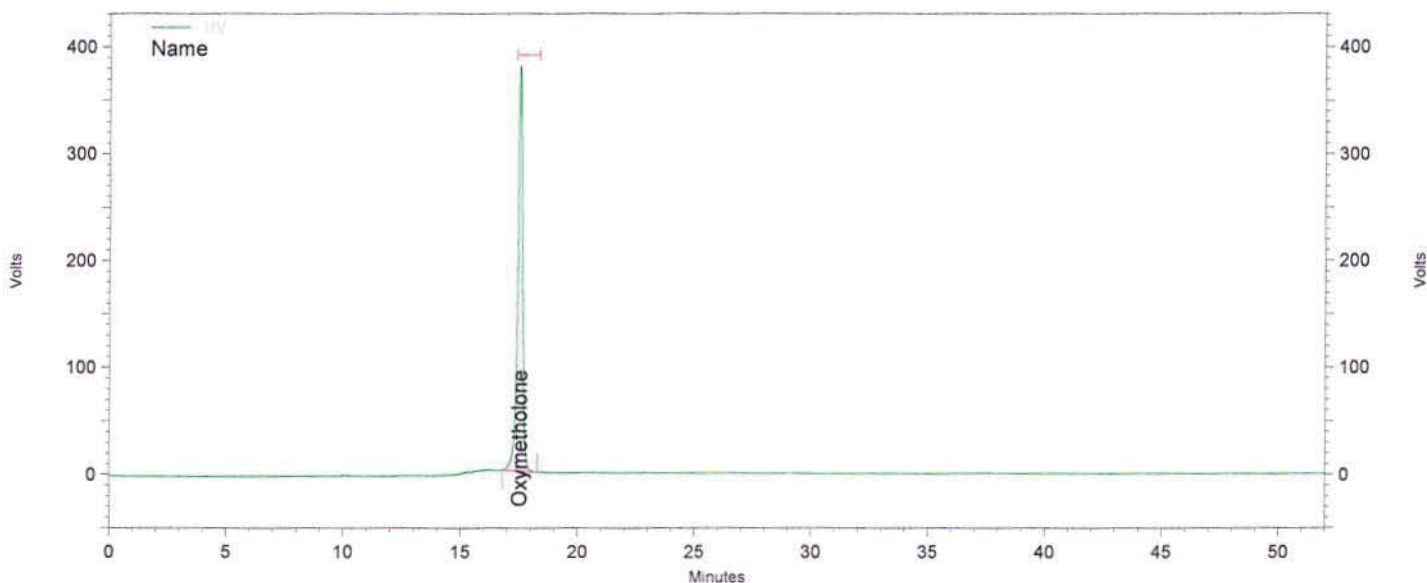

Channel A

UV Results


Name	Time	Area	Amount	Area Percent
Oxymetholone	17,533	21339736	0,000	100,000

Totals		21339736	0,000	100,000
--------	--	----------	-------	---------

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\April 2016\Diverse  
 Steroide\19,04,16\067\_C42810 A-Rep3.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Oxymetholone\_UV290.met

**Report steroid analysis**

HPLC:	Nr.5	Druckdatum:	26.04.2016 11:07:09
Analysendatum:	26.04.2016 03:44:06	Injektvolumen:	20
Vial:	53		
Probenidentifikation:	C42810 B		
Operator:	admin		
Chrom.-Beding.	ACN / Wasser, gradient		
Temperatur:	40 °C		
Säule	Nr. 85, 250 x 4,6, C18		
Detektion:	UV 240nm		

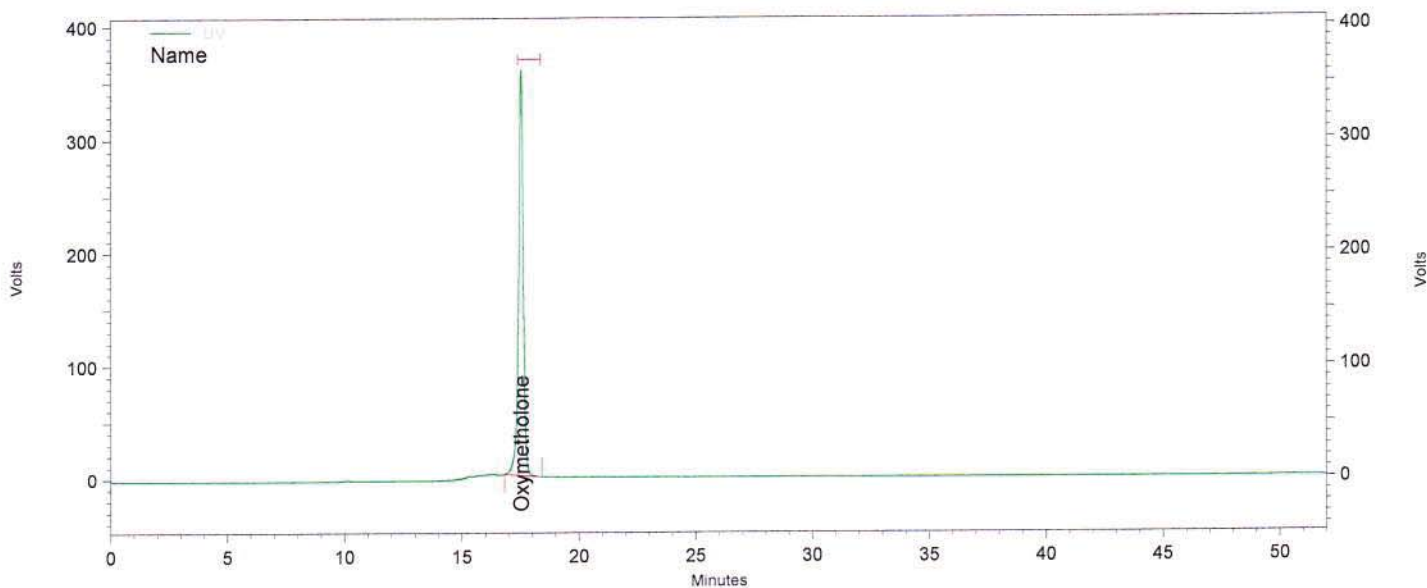

**Channel A**

UV Results

Name	Time	Area	Amount	Area Percent
Oxymetholone	17,537	20032880	0,000	100,000

Totals		20032880	0,000	100,000
--------	--	----------	-------	---------


Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\April 2016\Diverse  
Steroide\19,04,16\068\_C42810 B-Rep1.dat  
Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Oxymetholone\_UV290.met



Report steroid analysis

HPLC: Nr.5  
 Analysendatum: 26.04.2016 04:37:25  
 Vial: 53  
 Probenidentifikation: C42810 B  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Temperatur: 40 °C  
 Säule Nr. 85, 250 x 4,6, C18  
 Detektion: UV 240nm

Druckdatum: 26.04.2016 11:07:13  
 Injektvolumen: 20

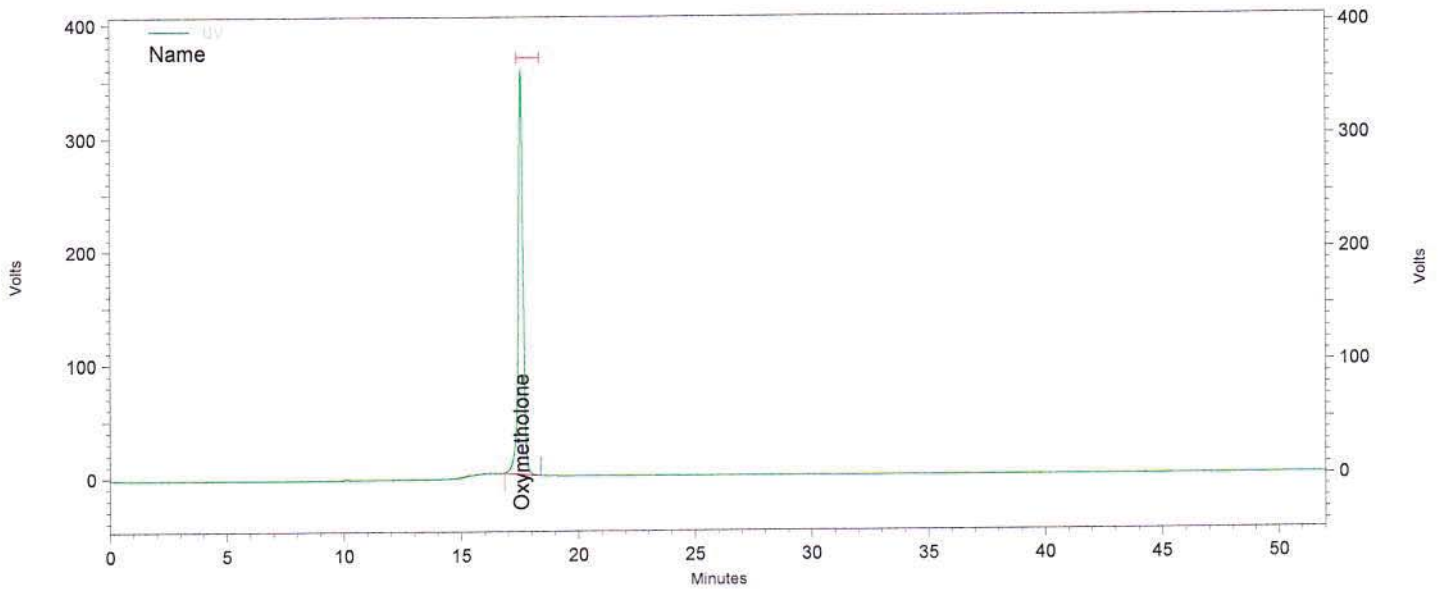

Channel A


UV Results				
Name	Time	Area	Amount	Area Percent
Oxymetholone	17,563	19994522	0,000	100,000
Totals		19994522	0,000	100,000

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\April 2016\Diverse  
 Steroide\19,04,16\068\_C42810 B-Rep2.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Oxymetholone\_UV290.met

Report steroid analysis

HPLC: Nr.5  
 Analysendatum: 26.04.2016 05:30:53  
 Vial: 53  
 Probenidentifikation: C42810 B  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Temperatur: 40 °C  
 Säule Nr. 85, 250 x 4,6, C18  
 Detektion: UV 240nm

Druckdatum: 26.04.2016 11:07:18  
 Injektvolumen: 20

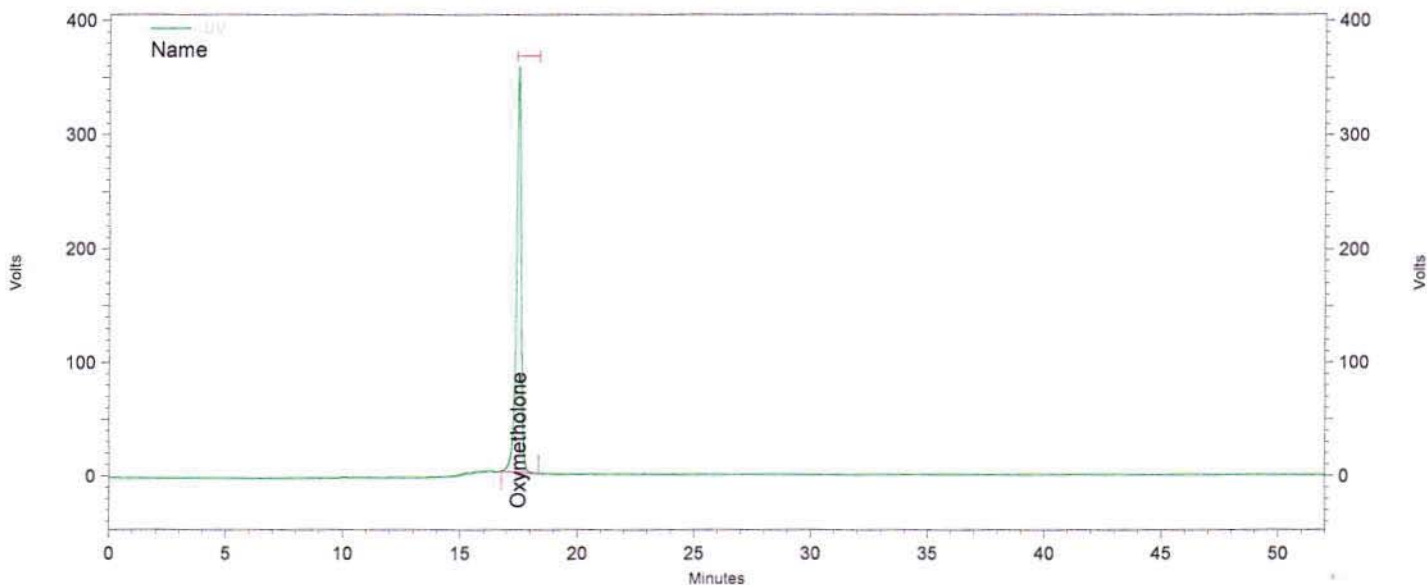

Channel A

UV Results

Name	Time	Area	Amount	Area Percent
Oxymetholone	17,487	19899973	0,000	100,000

Totals		19899973	0,000	100,000
--------	--	----------	-------	---------

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\April 2016\Diverse  
 Steroide\19,04,16\068\_C42810 B-Rep3.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Oxymetholone\_UV290.met